GREAT LAKES RACK PDU SPECIFICATION

Specific Configuration	ns						
COLOR	CAR	CARBON RED		WHITE			
WHIP LENGTH	6 FT	10 FT	6 FT	10 FT	6 FT	10 FT	
MONITORED MODEL	GL8246M-06C	GL8246M-10C	GL8246M-06R	GL8246M-10R	GL8246M-06W	GL8246M-10W	
SWITCHED READY MODEL	GL8246S-06C	GL8246S-10C	GL8246S-06R	GL8246S-10R	GL8246S-06W	GL8246S-10W	
DESCRIPTION	RACK PDU, 41", 20A 208/240V 1PH, 28-C13, L6-20P, CORDLOK						
MONITORING	REMOTE COMM & UNIT DISPLAY, ENVIROLOK READY						
SWITCHING	REMOTE COMM & UNIT DISPLAY, ENVIROLOK READY, SWITCHLOK READY						
POWER	20A 208/240V 1PH (3.3 kW)						
PLUG TYPE	L6-20P						
UNIT LENGTH	41 INCHES						
RECEPTACLES	28-C13						
CORDLOK	YES						
Universal Specification	n						
Over Current Protection		None	None				
Power Whip		See PDU R	See PDU Ratings Table - page 2				
Heavy Steel - Powder Coat Color		Per PowerL	Per PowerLok specific configuration for color				
Rack PDU Type		Vertical Rad	Vertical Rack-mount				
Toolless Mounting: Center Spacing		24.50"	24.50"				
Manufactured in the USA		Yes	Yes				

Power Whip	See PDU Ratings Table - page 2
Heavy Steel - Powder Coat Color	Per PowerLok specific configuration for color
Rack PDU Type	Vertical Rack-mount
Toolless Mounting: Center Spacing	24.50"
Manufactured in the USA	Yes
Product Warranty	3-year from date of shipment, repair or replace.
Certification/Agency Approvals	TUV Certified to UL/CSA 60950-1 with NOM Addendum for Mexico, FCC Part 15 Class A conformance, RoHS compliant
Operating Environment	0-60C (32-149F), 5-95% relative humidity, 0-10,000ft (0-3000 meters) elevation.
Storage Environment	-25-65C (-13-149F), 5-95% relative humidity, 0-10,000ft (0-3000 meters) elevation.
Chassis Dimensions (LxWxD)	40.98"L x 2.18"W x 2.0"D
Package Dimensions (LxWxD)	49.0"L x 22.0"W x 4.8"D (3&4-Pack), 49.0"L x 11.0"W x 4.8"D (1&2-Pack)
Pallet Dimensions (LxWxD)	49"L x 44"W x 5.0"D
Rack PDU Weight	12.0 lbs.
Packaged Weight (each)	14.0 lbs.
Monitored & Switched Versions On	ly
Monitoring Accuracy	Voltage: +/- 0.5% at nominal. Current: within 0.5% from 1A to 30A typical. +/1% of measurement from 500mA to 30A.
Total Unit & Group Monitoring	Aggregate (kWh, W, VA) plus Phase: A, B, C Line Currents, plus Group: 1, 2, 3 Monitoring (kWh, W, VA, PF, V, A)
Network Interface	Ethernet RJ-45, 10 Mbit/s, 100 Mbit/s
Transport/Internet	TCP/IP v4_v6

Monitored & Switched Versions C	nly
Monitoring Accuracy	Voltage: +/- 0.5% at nominal. Current: within 0.5% from 1A to 30A typical. +/1% of measurement from 500mA to 30A.
Total Unit & Group Monitoring	Aggregate (kWh, W, VA) plus Phase: A, B, C Line Currents, plus Group: 1, 2, 3 Monitoring (kWh, W, VA, PF, V, A)
Network Interface	Ethernet RJ-45, 10 Mbit/s, 100 Mbit/s
Transport/Internet	TCP/IP v4, v6
Network Applications	HTTP/HTTPS Webserver SNMP-V1/V2c/V3 Network Management DHCP for dynamic IP address request from a server on the network. Remote firmware upgrade using FTP.
Touch & Rotatable Digital Display	Touch to rotate / touch to view data screens
Internal RMS Voltage Sensor	Yes
Internal RMS Current Sensor	Yes
Environmental Monitoring	Optional EnviroLok daisy chain temp/humidity (optional - up to 4 sensors). Monitoring accuracy +/- 0.2C and +/- 2% Rh.

MADE AND ROBOTICALLY SOLDERED IN THE GREAT LAKES				
*CUSTOMER SIGNATURE:	DATE:	UNLESS OTHERWISE SPECIFIED, ALL	Great Lakes Data Racks and Cabinets	
*PRIOR TO MANUFACTURING, BUILD MODELS REQUIRE CUSTOMER SIGN-OFF. BY SIGNING, CUSTOMER AGREES THAT THIS ORDER IS NON- CANCELABLE AND NON-RETURNABLE.		DIMENSIONS ARE IN MM AND TOLERANCES ARE: X = +/- 0.5	TITLE: RACK PDU SPECIFICATION	
		.X = +/- 0.25 .XX = +/- 0.13 X* = +/- 0.5*	DRAWING NUMBER: SP-GL8246	SHEET: 1 OF 2
THE CRECIFICATION AND ITS	CONTENITO ARE THE	DODERTY OF CREAT LAKES DA	TA DACKS AND CADINITIS AND	CUALL NOT DE

BLUE

10 FT GL8246M-10B

GL8246S-10B


6 FT

GL8246M-06B GL8246S-06B


Example drawing shown. See table for actual receptacle configuration.


MONITORED VERSIONS ONLY


THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF GREAT LAKES DATA RACKS AND CABINETS AND SHALL NOT BE COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY GREAT LAKES. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE.

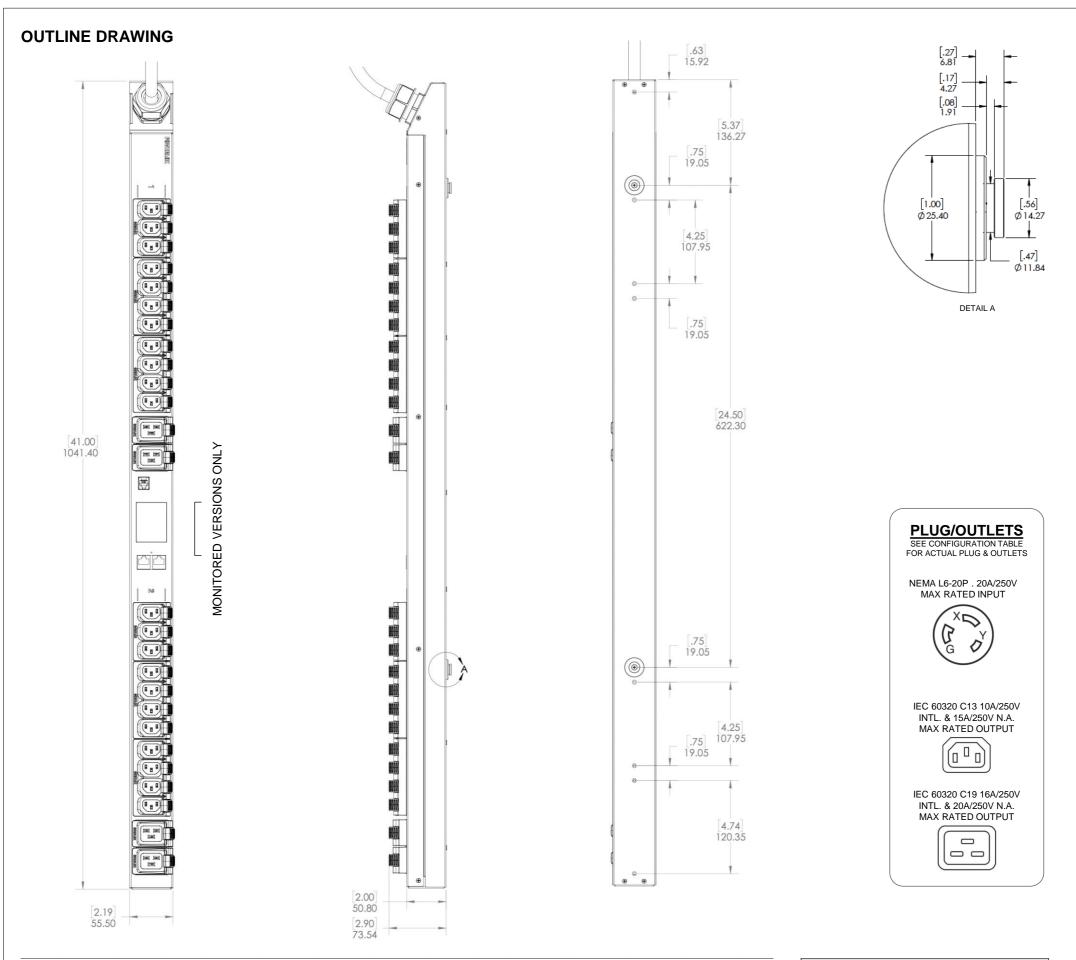

PDU WIRING DIAGRAM & RATINGS TABLE

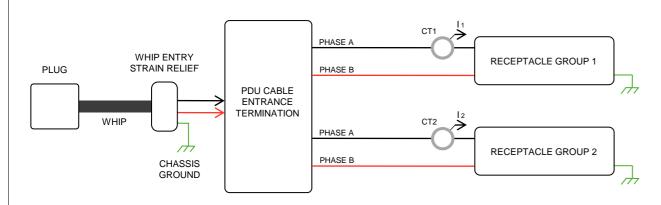



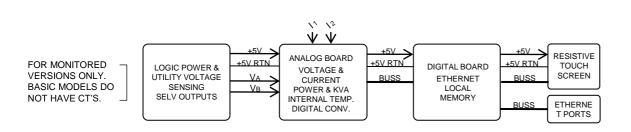

MADE AND ROBOTICALLY SOLDERED IN THE

GREAT LAKES

*CUSTOMER SIGNATURE:	DATE:	UNLESS OTHERWISE SPECIFIED, ALL	Great Lakes Data Racks and Cabinets		
PRIOR TO MANUFACTURING, BUILD MODELS REQUIRE CUSTOMER SIGN-OFF. BY SIGNING, CUSTOMER AGREES THAT THIS ORDER IS NON- CANCELABLE AND NON-RETURNABLE.		DIMENSIONS ARE IN MM AND TOLERANCES ARE: X = +/- 0.5 .X = +/- 0.25 .XX = +/- 0.13 X = +/- 0.5*	TITLE: RACK PDU SPECIFICATION		
			DRAWING NUMBER: SP-GL8246	SHEET: 2 OF 2	

THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF GREAT LAKES DATA RACKS AND CABINETS AND SHALL NOT BE COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY GREAT LAKES. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE.