GREAT LAKES RACK PDU SPECIFICATION

Specific Configuratio	pecific Configurations							
COLOR	CARBON		RED		WHITE		BLUE	
WHIP LENGTH	6 FT	10 FT	6 FT	10 FT	6 FT	10 FT	6 FT	10 FT
SWITCHED READY MODEL	GL8401S-06C	GL8401S-10C	GL8401S-06R	GL8401S-10R	GL8401S-06W	GL8401S-10W	GL8401S-06B	GL8401S-10B
MONITORED MODEL	GL8401M-06C	GL8401M-10C	GL8401M-06R	GL8401M-10R	GL8401M-06W	GL8401M-10W	GL8401M-06B	GL8401M-10B
BASIC MODEL	GL8401B-06C	GL8401B-10C	GL8401B-06R	GL8401B-10R	GL8401B-06W	GL8401B-10W	GL8401B-06B	GL8401B-10B
DESCRIPTION	RACK PDU, 72", 30A 208/240V DELTA 3PH, 48-C13, L15-30P, CORDLOK							
POWER	30A 208/240V DELTA 3PH (10.0 kW)							
PLUG TYPE	L15-30P							
UNIT LENGTH	72 INCHES							
RECEPTACLES	48-C13							
CORDLOK	YES							


Universal Specification	
Over Current Protection	20A UL489 magnetic breakers
Power Whip	See PDU Ratings Table - page 2
Heavy Steel - Powder Coat Color	Per PowerLok specific configuration for color
Rack PDU Type	Vertical Rack-mount
Toolless Mounting: Center Spacing	61.25"
Manufactured in the USA	Yes
Product Warranty	3-year from date of shipment, repair or replace.
Certification/Agency Approvals	TUV Certified to UL/CSA 60950-1 with NOM Addendum for Mexico, FCC Part 15 Class A conformance, RoHS compliant
Operating Environment	0-60C (32-149F), 5-95% relative humidity, 0-10,000ft (0-3000 meters) elevation.
Storage Environment	-25-65C (-13-149F), 5-95% relative humidity, 0-10,000ft (0-3000 meters) elevation.
Chassis Dimensions (LxWxD)	72.0"L x 2.18"W x 2.0"D
Package Dimensions (LxWxD)	80.0"L x 22.0"W x 4.8"D (3&4-Pack), 80.0"L x 11.0"W x 4.8"D (1&2-Pack)
Pallet Dimensions (LxWxD)	82"L x 44"W x 5.0"D
Rack PDU Weight	15.0 lbs.
Packaged Weight (each)	17.0 lbs.
Monitored & Switched Versions	
Only	
MONITORING TYPE:	REMOTE & TOUCHSCREEN DISPLAY, ENVIROLOK READY. SWITCHED READY
Monitoring Accuracy	Voltage: +/- 0.5% at nominal. Current: within 0.5% from 1A to 30A typical. +/1% of measurement from 500mA to 30A.
Total Unit & Group Monitoring	Aggregate (kWh, W, VA) plus Phase: A, B, C Line Currents, plus Group: 1, 2, 3 Monitoring (kWh, W, VA, PF, V, A)
Network Interface	Ethernet RJ-45, 10 Mbit/s, 100 Mbit/s
Transport/Internet	TCP/IP v4, v6
Network Applications	HTTP/HTTPS Webserver SNMP-V1/V2c/V3 Network Management DHCP for dynamic IP address request from a server on the network. Remote firmware upgrade using FTP.
Touch & Rotatable Digital Display	Touch to rotate / touch to view data screens
Internal RMS Voltage Sensor	Yes
Internal RMS Current Sensor	Yes
Environmental Monitoring	Optional EnviroLok daisy chain temp/humidity (optional - up to 4 sensors). Monitoring accuracy +/- 0.2C and +/- 2% Rh.


MADE AND ROBOTICALL USA	Y SOLDERED	IN THE
*CUCTOMED CICMATURE	DATE	

GREAT LAKES

		— , — ,	", ,	
DATE:	UNLESS OTHERWISE SPECIFIED, ALL	····- I Caninote	acks and	
,	AND TOLERANCES ARE:	TITLE: RACK PDU SPECIFICATION		
	.X = +/- 0.25 .XX = +/- 0.13 X° = +/- 0.5°	DRAWING NUMBER: SP-GL8401	SHEET: 1 OF 2	
	DATE: G, BUILD MODELS FF. BY SIGNING, IS ORDER IS NON- IRNABLE.	DATE: UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN MM AND TOLERANCES ARE: FF. BY SIGNING, IS ORDER IS NON- JRNABLE. UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN MM AND TOLERANCES ARE: X = +/- 0.5 X = +/- 0.25 XX = +/- 0.13	UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN MM AND TOLERANCES ARE: TITLE: RACK PDU SPECIFICAT X = +/- 0.5 IS ORDER IS NON- JRNABLE. XX = +/- 0.13 X = +/- 0.13 DRAWING NUMBER:	

THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF GREAT LAKES DATA RACKS AND CABINETS AND SHALL NOT BE COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY GREAT LAKES. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE.

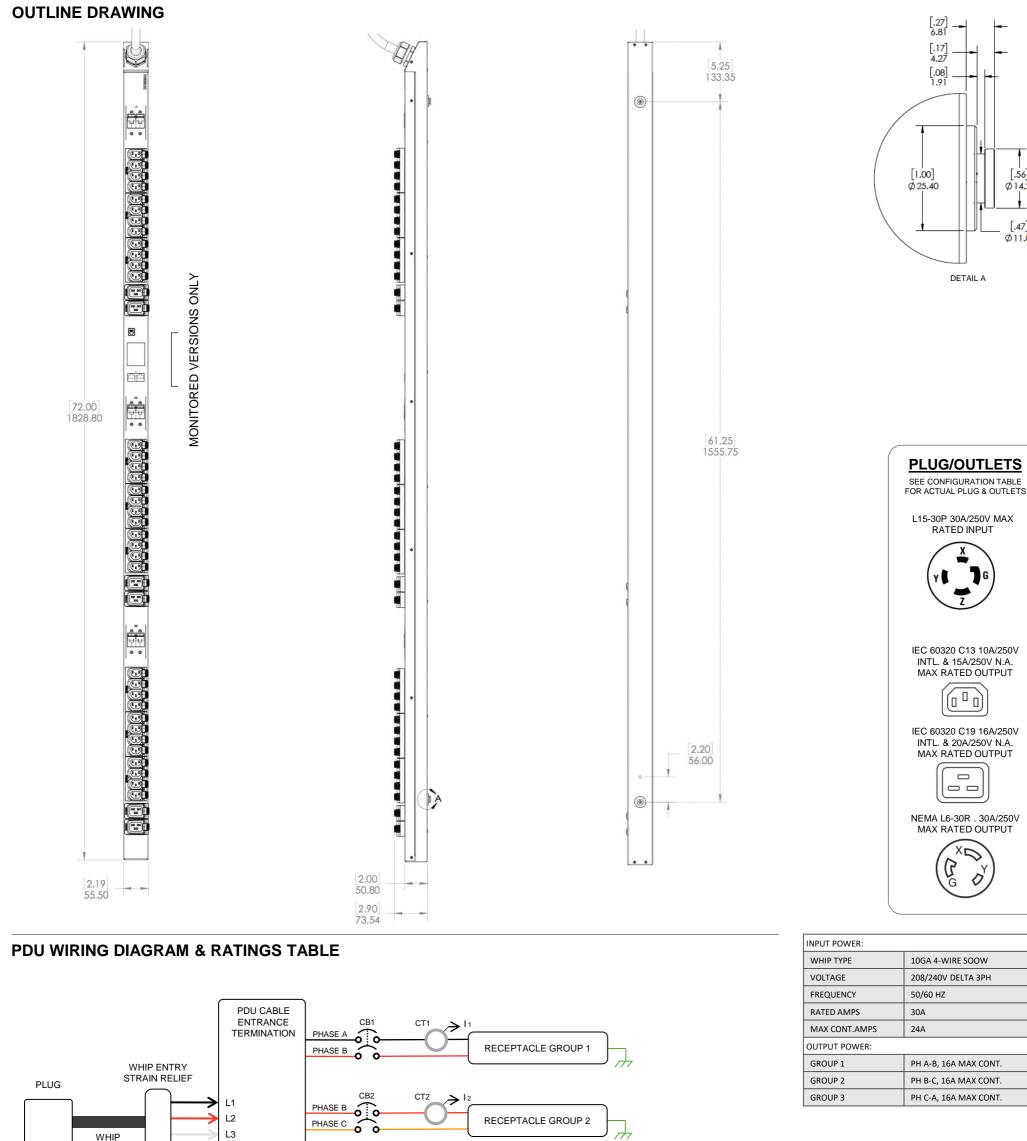

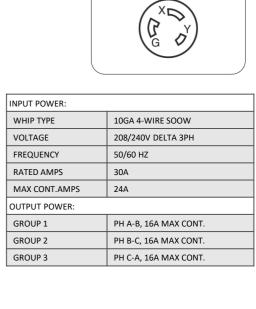

GREAT LAKES

[.08] 1.91

Ø14.27

.47 Ø11.84

DETAIL A



FOR MONITORED

VERSIONS ONLY. CT1-3 NOT ON

BASIC MODELS.

+5V RTN

 V_A

V_B V_C

DIGITAL CONV.

LOGIC POWER & UTILITY VOLTAGE SENSING

SELV OUTPUTS

					USA				
				*CUSTOMER SIGNATURE:	DATE:	UNLESS OTHERWISE SPECIFIED, ALL	Great Lakes Data Racks and Cabinets		
\(\frac{\frac{1}{\gamma}}{\sqrt{\gamma}}\)		*PRIOR TO MANUFACTURING, REQUIRE CUSTOMER SIGN-OFF		DIMENSIONS ARE IN MM AND TOLERANCES ARE: X = +/- 0.5	TITLE: RACK PDU SPECIFICATION				
NALOG BOARD VOLTAGE & CURRENT	+5V +5V RTN BUSS	DIGITAL BOARD ETHERNET	+5V +5V RTN BUSS	RESISTIVE TOUCH SCREEN	CUSTOMER AGREES THAT THIS CANCELABLE AND NON-RETUR	ORDER IS NON-	X = +/- 0.25 .XX = +/- 0.13 X* = +/- 0.5*	DRAWING NUMBER: SP-GL8401	SHEET: 2 OF 2
POWER & KVA NTERNAL TEMP.		LOCAL MEMORY		ETHERNE	THIS SPECIFICATION AND ITS C	CONTENTS ARE THE	PROPERTY OF GREAT LAKES DA	TA RACKS AND CABINETS AND	SHALL NOT BE

ETHERNE T PORTS

MADE AND ROBOTICALLY SOLDERED IN THE

THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF GREAT LAKES DATA RACKS AND CABINETS AND SHALL NOT COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY GREAT LAKES. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE.